

This is a summary of all the available water sampling at this time related to the potomac interceptor sewage spill. The color coding is meant to be a quick reference to show readings above and below the public health US EPA standard for E. Coli.

> 70X recreation limit	Consistent with public health and US EPA standards swimming is not recommended when E. coli levels exceed 410 MPN/100ML
> 1X recreation limit	
< recreation limit	

DC WATER water testing

Sample Date	E. Coli (MPN/100ML)					
	Old Anglers Inn (upstream of collapse)	Near Drainage Channel @ Overflow (Swainson Island)	Fletcher's Boathouse	Georgetown @ Wisconsin Ave	National Harbor	Anacostia @ S. Cap St
1/29/2026	11	570,000	143,000	18,600	<1	2
1/30/2026	4	60,000	3,000	2,700	3	11
1/31/2026	3	30,000	1,200	5,100	2	6
2/1/2026	27	80,000	488	300	4	21
2/2/2026	6	242,000	397	173	31	6
2/3/2026	4	460,000	68	53	15	30
2/4/2026	5	210,000	49	48	178	45
2/5/2026	1	77,000	38	84	33	16
2/6/2026	22	242,000	108	238	10	23
2/7/2026	15	86,600	79	114	24	16
2/8/2026	15	130,000	260	43	27	47
2/9/2026	16	730,000	20	20	<1	5
2/10/2026	7	600,000	17	20	2	2
2/11/2026	8	600,000	3	19	6	<1


DC Water Map sampling locations



Potomac RiverKeepers in Partnership with University of Maryland water sampling

Sample Taken	1/23/2026		1/28/2026		2/3/2026	
	Location	E. Coli Levels (MPN)	X Higher than Recreation Limit (410MPN/100ML)	E. Coli Levels (MPN)	X Higher than Recreation Limit (410MPN/100ML)	E. Coli Levels (MPN)
Old Angler's Inn (Upstream)	4.1	N/A	52	N/A	1	N/A
Potomac River near Cabin John at Lock 10	455,400	11,912	1,119,900	2,793	1,732,900	4,227
Lock House 10 Public River Access	290,000	7,095	920,000	7,246	1,119,900	2,731
Little Falls Pumping Station, USGS gauge	24,198	59	17,090	44	860	2
Little Falls/Lock 5			16,160	39	630	1.54
Fletcher's Cove			7,703	19	6.3	N/A
Washington Canoe Club			689	2	47.9	N/A
Thompson Boat Launch			24,195	59	74.3	N/A
National Harbor			1	N/A	8.5	N/A

Potomac RiverKeeps/UMD Map sampling locations

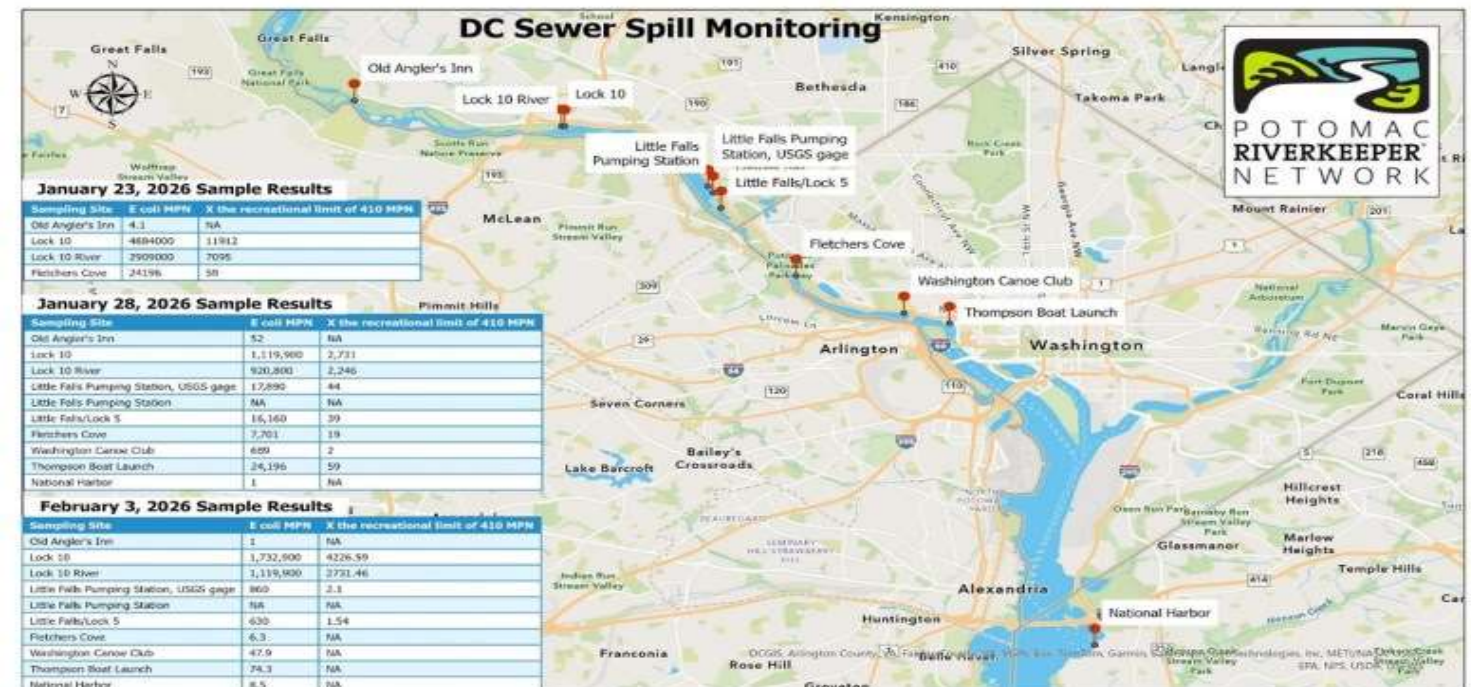

DOEE water sampling - starting 2/9/2026

Sample Date	E. Coli (MPN/100ML)					
	Fletcher's Cove	Key Bridge	14th St. Bridge	Washington Ship Channel	South Capitol St. Bridge	Pennsylvania Ave. Bridge
2/9 - 2/10 20206	387	203	93	19	1	9

DOEE Sampling Map (Blue dots are DC Water sampling locations, Red dots are DOEE sampling locations)

